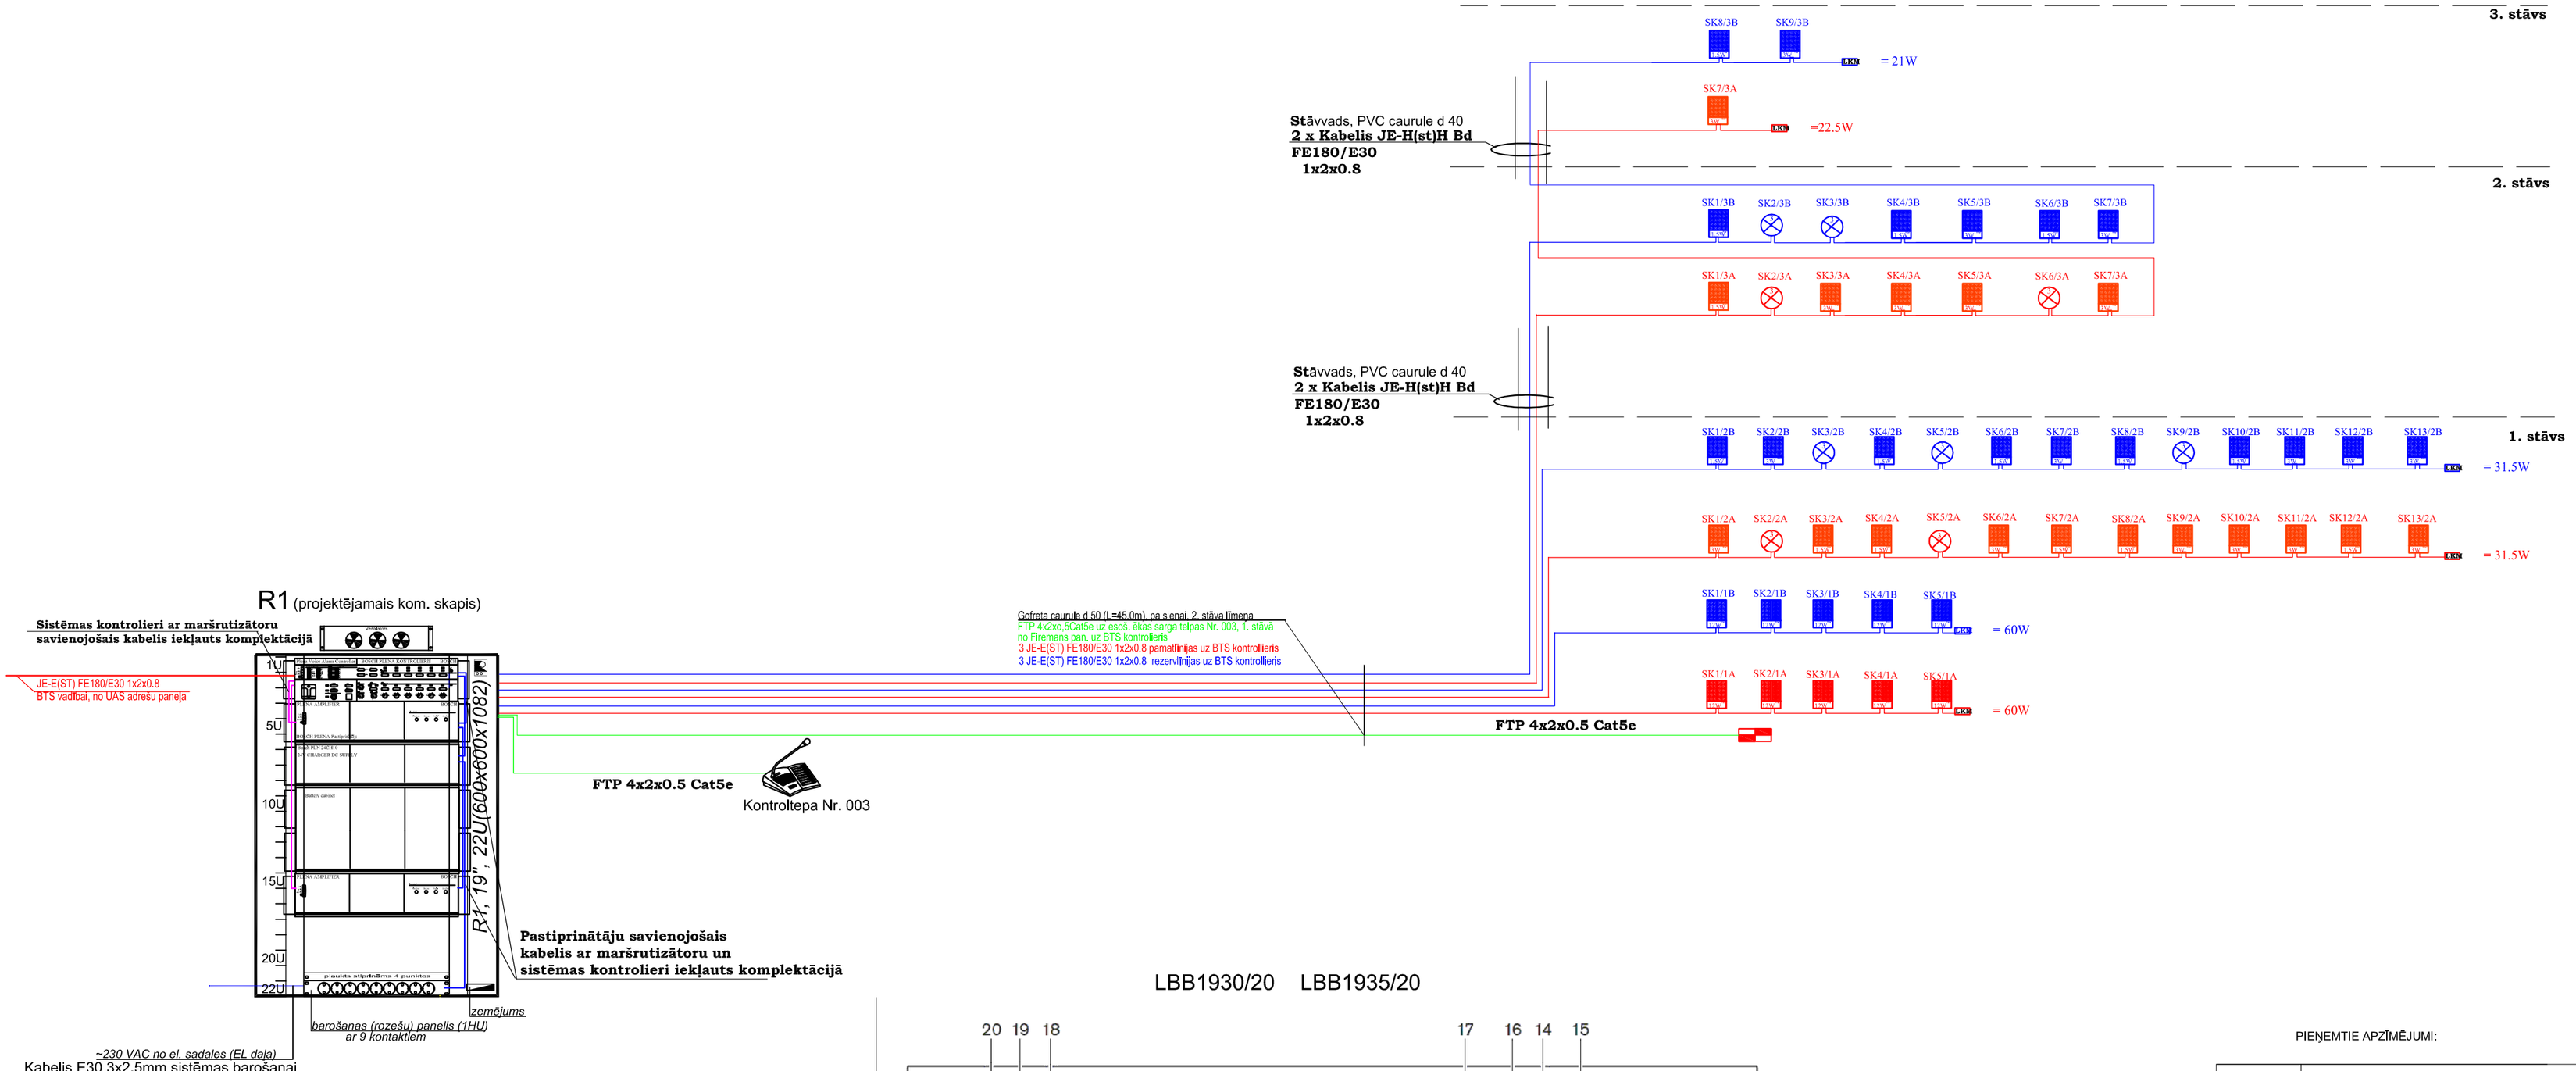

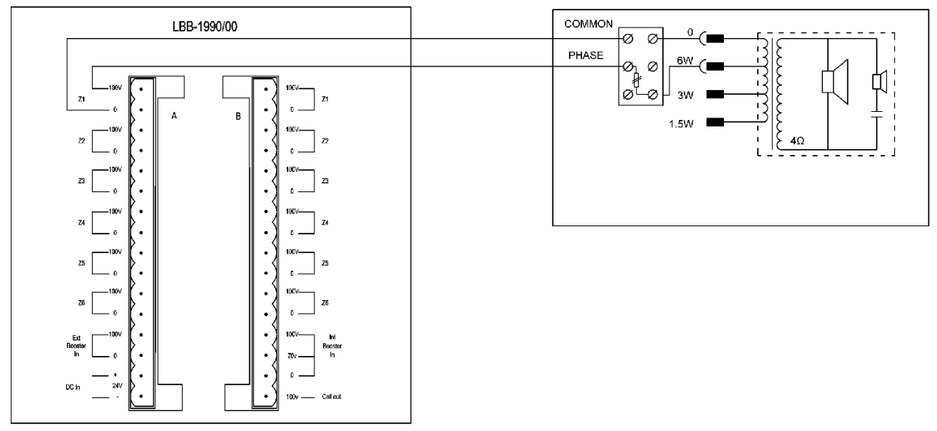

LBB1930/20 LBB1935/20

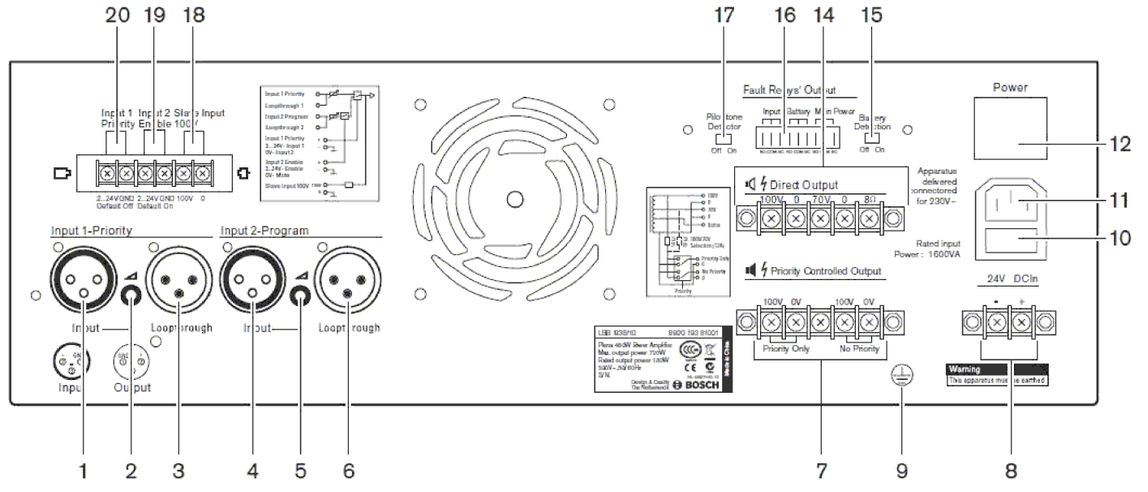

1 **Priority line** - input 1 (XLR/balanced)
2 **Level control** - input 1
3 **Line loopthrough 1** (XLR/balanced)
4 **Program line** - input 2 (XLR/balanced)
5 **Level control** - input 2
6 **Line loopthrough 2** (XLR/balanced)
7 **Priority controlled loudspeaker** output terminals
8 **24 Vdc** power supply terminals
9 **Earth** connection screw
10 **Mains fuse** (T10A)
12 **ON - OFF switch**
13 **Voltage selector**
14 **Loudspeaker direct** output terminals
15 **Battery detection**
16 **Fault relay output**
17 **Pilot-Tone detection**
18 **100 V** slave input terminals
19 **Input 2 enable** control terminals
20 **Input 1 priority** control terminals

PIEŅEMTIE APZĪMĒJUMI:

Apz.	Nosaukums
	Kontroles panelis PLENA (Montāžas skapis)
	Kontroles paneļa PLENA FIREMAN PANEL
Sk 1/1 A	Skaļrunis sienas 1,5W; 3,0W; 6,0W pamatlīnija
Sk 13/2 A	Skaļrunis griestu 1,5W; 3,0W; 6,0W pamatlīnija
Sk 1/1 B	Skaļrunis sienas 1,5W; 3,0W; 6,0W rezervlīnija
Sk 13/2 B	Skaļrunis griestu 1,5W; 3,0W; 6,0W rezervlīnija
Sk 13/2 A	Skaļrunis sienas 3,0W; 6,0W; 12,0W rezervlīnija
	Paziņojumu stacija ar mikrofonu
LKM	Līnijas kontroles modulis
	Kabelis JE-H(st)H Bd FE180/E30 1x2x0.8 rezervlīnija
	Kabelis JE-H(st)H Bd FE180/E30 1x2x0.8 rezervlīnija
	Kabelis FTP 4x2x0.5 Cat5

Daļas vadītājs	G. Samčuks		
Izstrādāja	A. Meļniks		

ADRESE: Filozofu iela 50, Jelgava

OBJEKTS: "Jelgavas 2. internātpamatskolas" rekonstrukcija, sporta zāles ar rehabilitācijas telpām jaunbūve, teritorijas labiekārtošana 1. kārta

PASŪTĪTĀJS: Jelgavas pilsētas pašvaldības izglītības iestāde "Jelgavas 2. internātpamatskola", Reģ. Nr. 90000074738

RASĒJUMS: BALSS TRAUKSMES IZZIŅOŠANAS SISTĒMA
BTS LĪNIJAS PIESLĒGUMA SHĒMA

FAILS:	PASŪTĪJUMA NR.:	STADIJA:
	2014-01/12	TP
MĒROGS: BM	LAPU SKAITS: 12	LAPA: UAS-2-5

BALTEX GROUP
Dīķa iela 44, Rīga, LV1004, 66662080, www.baltexgroup.lv